


# SHIELDskin XTREME™

A REVOLUTION IN GLOVE TECHNOLOGY

## DI

BASIC  
CONTAMINATION CONTROL

# SHIELDskin XTREME™ ORANGE NITRILE™ 300 DI

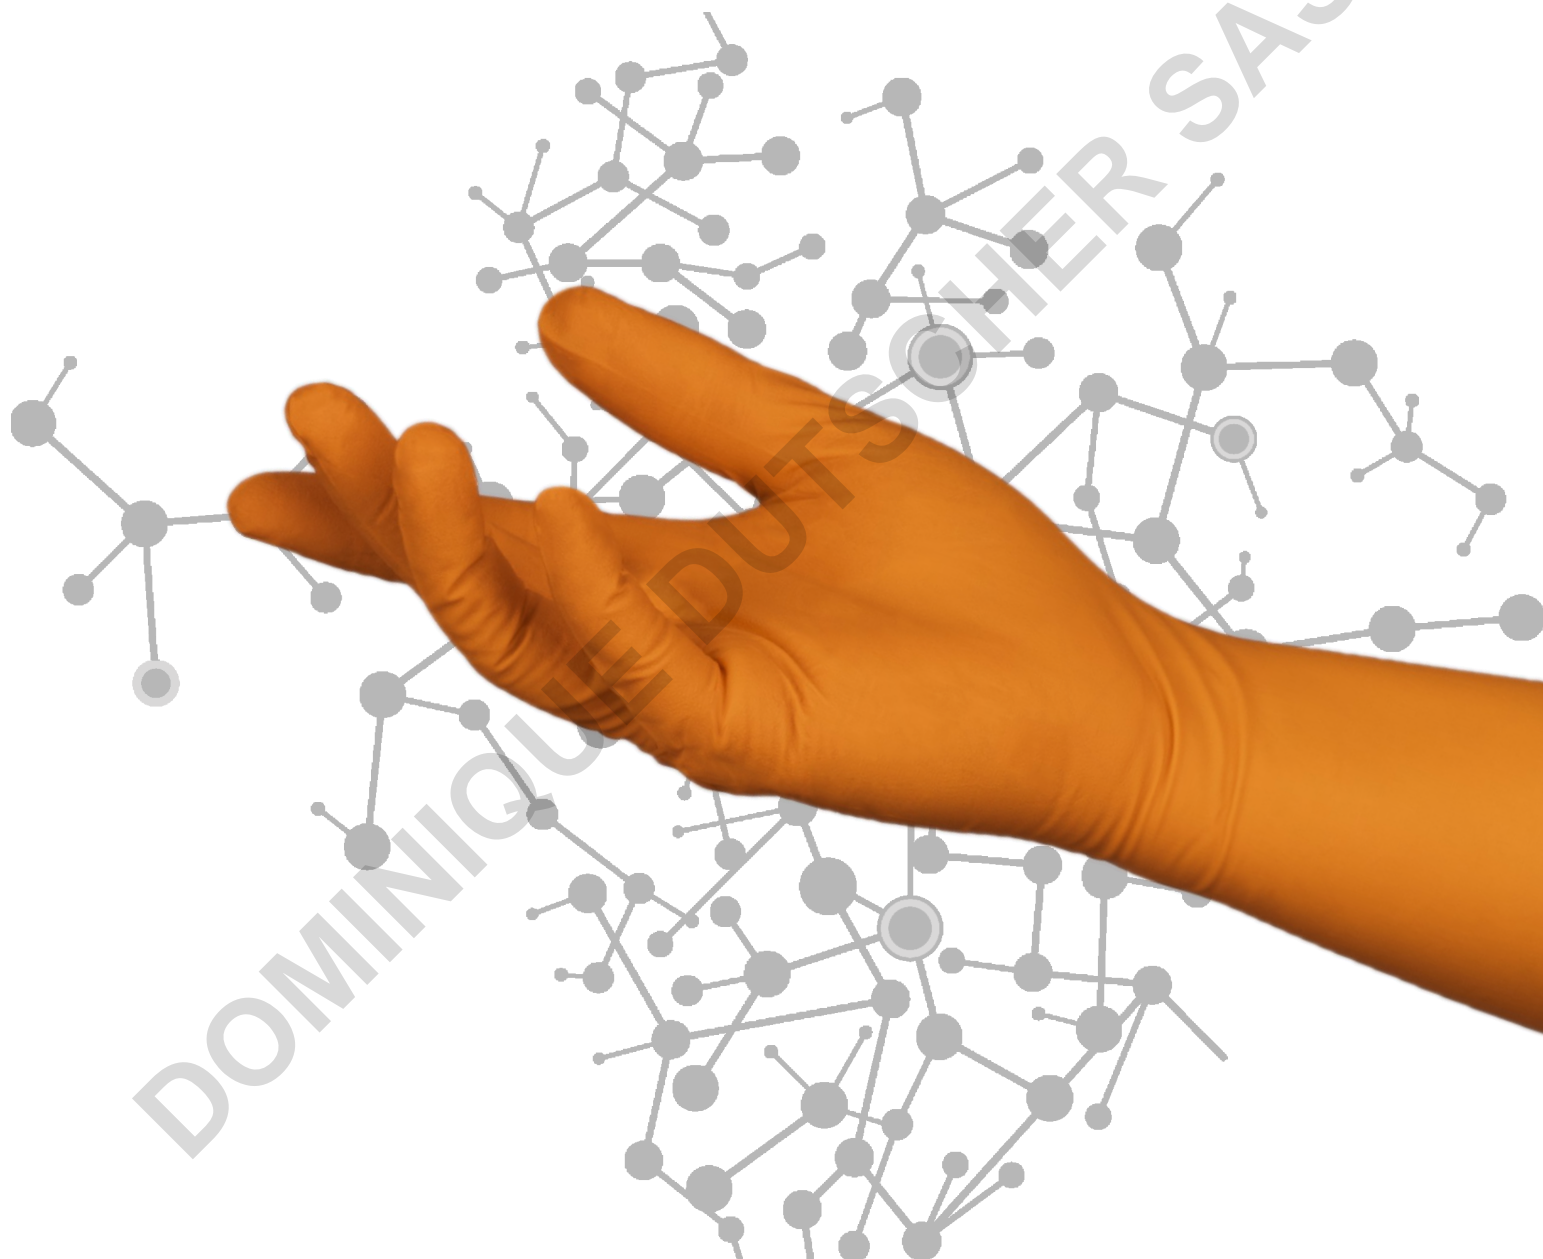



DI

Basic  
contamination  
control

- ⇒ Powder-free single DI washed ambidextrous standard length (300 mm / 11.8") non-sterile nitrile/neoprene cleanroom gloves.
- ⇒ Personal Protective Equipment Category III (PPE - Complex Design) according to Regulation (EU) 2016/425.
- ⇒ Fully compliant to the latest PPE Protective gloves EU norms against chemicals, micro-organisms and viruses.

DESCRIPTION	
Formulation	Nitrile and neoprene synthetic rubber ( <i>Acrylonitrile butadiene and polychloroprene</i> ).
Design	Orange, ambidextrous, beaded cuff, textured fingertips.
Packaging	100 gloves per double sealed PE bag - 10 double sealed PE bags per tied carton liner - 1 tied carton liner per carton = 1000 gloves.

SIZES	6/XS	7/S	8/M	9/L	10/XL	11/XXL
Codes	69 6451	69 6452	69 6453	69 6454	69 6455	69 6456

STANDARDS	
CE/UKCA registration	PPE Category III (Complex Design) - Regulation (EU) 2016/425. CE Notified Body No 2797: BSI Group The Netherlands B.V., Say Building, John M. Keynesplein 9, Unit 4.2, 1066 EP Amsterdam, The Netherlands. UKCA Notified Body No 0086: BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes, MK5 8PP, United Kingdom.
EU PPE norms	ISO 21420:2020+A1:2022, ISO 374-1:2016+A1:2018, ISO 374-2:2019, ISO 374-4:2019, ISO 374-5:2016, EN 16523-1:2015+A1:2018 and ISO 16604:2004 Procedure B.
EU MDR norms <sup>1</sup>	EN 455-1:2020, EN 455-2:2015, EN 455-3:2015 and EN 455-4:2009.
USA standards	ASTM D3767-03 (2020), ASTM D573-04 (2019), ASTM D412-16, ASTM D6978-05 (2019) and IEST-RP-CC005.4 (2013).
Other standards	EN 1149-1/2/3 & 5, ISO 10993-10:2021.

<sup>1</sup>With reference to Regulation (EU) 2017/745 for Medical Devices

QUALITY	
Quality assurance	Production management in accordance with ISO 9001:2015 and ISO 13485:2016. Environmental management systems in accordance with ISO 14001:2015.
Technology	twinSHIELD™ double-walled protection to offer a stronger glove and to reduce risk of pinholes. Two colours: orange to make it easier to select according to the risk, combined with a soft and comfortable white interior. Compatible with clean processing environments due to paperless packaging and multiple post leaching of gloves (single washed in deionised water).

DOCUMENTATION	
Declaration of conformity	These documents can be freely downloaded from the product page on our website: <a href="http://www.shieldscientific.com">www.shieldscientific.com</a> .
EU type examination certificate	For easy access, scan the QR code.
User's instructions	
Certificate of conformance	To access CoC, you need to be registered. Please contact us at <a href="mailto:info@shieldscientific.com">info@shieldscientific.com</a> or call your SHIELD Scientific representative.



# PHYSICAL PROPERTIES



NOMINAL THICKNESS	mm <sup>2</sup>	mil	Norm
⇒ Finger	0.19	7.5	ASTM D3767-03 (2020)
⇒ Palm	0.14	5.5	
⇒ Cuff	0.10	3.9	

<sup>2</sup> Thickness (+/- 0.03 mm)

LENGTH	Minimum	Typical	Norm
⇒ From middle finger tip to edge of cuff	≥ 290 mm / 11.4"	300 mm / 11.8"	ISO 21420:2020+A1:2022

STRENGTH PROPERTIES	Force at break (spec.)		Ultimate elongation (spec.)	Force at break (typical)	Norm
⇒ Before aging	≥ 6.0N	14 MPa	≥ 500%	10.0N	EN 455-2:2015 ASTM D573-04 (2019) & ASTM D412-16
⇒ After aging	≥ 6.0N	14 MPa	≥ 400%	8.0N	

FREEDOM FROM HOLES	Performance	Norm
⇒ Acceptable Quality Level (AQL)	< 0.25 <sup>3</sup> G1 - Level 3	ISO 374-2:2019

<sup>3</sup> AQL as defined per ISO 2859-1:1999 for sampling by attributes.

RISKS	Description	Norm
Micro-organisms	1000 ml water test. Performance level 3, AQL < 0.25 (inspection level G1).	ISO 374-2:2019
Viruses	Viral penetration test using Phi-X174 bacteriophage according to ISO 16604:2004 Procedure B.	ISO 374-5:2016
Chemicals	<u>Performance</u> : Type B (JKPT). <u>Permeation</u> : Extensively tested. Online chemical resistance guide on <a href="http://www.shieldscientific.com">www.shieldscientific.com</a> . <u>Degradation</u> : Tested for determination of resistance to degradation by chemicals.	ISO 374-1:2016+A1:2018 EN 16523-1:2015+A1:2018  ISO 374-4:2019
Cytotoxic	Tested for permeation by potentially hazardous cancer chemotherapy drugs under conditions of continuous contact.	ASTM D6978-05 (2019)

# CLEANLINESS PROPERTIES

PARTICLES	Specification	Typical value	Test method
Particles/cm <sup>2</sup> ≥ 0.5µm	< 3,000 particles	2,100 particles	IEST-RP-CC005.4

EXTRACTABLES (ION)	Specification (µg/cm <sup>2</sup> )	Typical value (µg/cm <sup>2</sup> )	Test method
Ammonium (NH <sub>4</sub> )	0.100	0.050	IEST-RP-CC005.4
Bromide (Br)	0.030	< 0.008	
Calcium (Ca)	0.750	0.580	
Chloride (Cl)	0.600	0.400	
Fluoride (F)	0.010	< 0.008	
Magnesium (Mg)	0.030	0.008	
Nitrate (NO <sub>3</sub> )	0.600	0.300	
Nitrite (NO <sub>2</sub> )	0.050	< 0.008	
Phosphate (PO <sub>4</sub> )	0.050	< 0.008	
Potassium (K)	0.050	0.030	
Sodium (Na)	0.080	0.030	
Sulphate (SO <sub>4</sub> )	0.200	0.070	

EXTRA TESTS	Description	Test method
NVR	Maximum 25 µg/cm <sup>2</sup> .	IEST-RP-CC005.4
FTIR	Silicone free and non-detectable levels of amide and DOP.	IEST-RP-CC005.4
ESD	Tested for electrostatic properties.	EN 1149-1/2/3 & 5

ALLERGIES	
Bio-Compatibility	Demonstrated by skin irritation and sensitisation tests in accordance with ISO 10993-10:2021.
Accelerators	Accelerator and sulphur free to minimise the risk of allergic contact dermatitis (also known as Type IV, delayed hypersensitivity or chemical allergy).
Chemical Allergens	Non-detectable levels using aqueous solution extraction (Phosphate buffered solution) and High Performance Liquid Chromatography (HPLC) assay method for quantitative analysis.
Latex Protein	Latex-free.